

FACTS: its Role in the Connection of Wind Power to Power Networks

C. Angeles-Camacho
Universidad Nacional Autónoma de
México, UNAM
México, D. F., México
cangelesc@ii.unam.mx

E. Fariñas-Wong
Universidad Central Las Villas
Villa Clara, Cuba
farinas@uclv.edu.cu

F. Bañuelos-Ruedas
Universidad Autónoma de
Zacatecas, UAZ
Zacatecas, México
fbauelosr@ii.unam.mx

Abstract—The introduction of large amounts of wind power into the grid increases the short-term variability of the loads as seen by the traditional generator, thus increasing the need for spinning reserve. Wind farm generation and in general non-conventional renewable energy has demonstrated some positive effects as an embedded generation. Also demonstrated are some adverse effects, mainly attributable to the fluctuating real power injection and (in case of fixed-speed induction turbines) to the varying absorption of reactive power. This leads to voltage deviations throughout the network that could affect system stability and power quality for customer. This paper analyses one solution to this problem. First, variable speed operation is described for wind generators, then the use of flexible alternating-current transmission systems (FACTS) controllers with fixed speed induction generator is considered.

Keywords—component; wind power; FACTS; power flows; dynamic power flows.

I. INTRODUCTION

The working power system with wind farms, given the randomness of the wind resource for high levels of penetration, power system stability must be strictly controlled to ensure the security and thus the continuity of electric service [1]. Wind generation is not considered safe in planning calculations for the operation of the power system as well if the degree of penetration is high it is considered that greatly affects the security of the system [2]. Coupled with the problems of planning and variability, we present the problem of the inability to store and/or transporting the primary source of energy: wind, thus completing wholly undesirable characteristics for drivers and electricity suppliers.

Because of the need to deliver low energy parameters regulated by country, in recent years have developed the power electronics devices, which allow interconnection of different energy sources, including those of random behavior as wind turbines, on the same network supply.

II. WHY POWER ELECTRONICS?

Power electronics deals with the processing of electrical energy. Power electronics is an enabling technology, providing the need interface between the electrical source and the electrical load. The electrical source and the electrical load can, and often do, differ in frequency, voltage amplitudes and the number of phases. Power electronics involves the interaction of

three elements: copper, which conducts electric current; iron, which conducts magnetic flux; and, in prime position, silicon [3].

The field is one of growing importance: it is estimated that, over half the electrical energy generated is processed by power electronics before its final consumption, a proportion that is likely to reach 90% during the next decades.

A. Benefits

- To convert electrical energy from one form to another, facilitating its regulation and control
- To achieve high conversion efficiency and therefore low loss
- To minimize the mass of power converters and the equipment (such as motors) that they drive.
- Intelligent use of power electronics will allow consumption of electricity to be reduced

Two kinds of emerging power electronics applications in power systems are already well defined:

- a) Bulk active and reactive power control
- b) Power quality improvement [4]

The first application area is known as FACTS, where the latest power electronic devices and methods are used to electronically control high-voltage side of the network [5]. The second application area is custom power, which focuses on low voltage distribution and is a technology created in response to reports of poor power quality and reliability of supply affecting factories, offices and homes. It is expected that when widespread deployment of the power electronics technology takes place, the end-user will see tighter voltage regulation, minimum power interruptions, low harmonic voltages, and acceptance of rapidly fluctuating and other non-linear loads in the vicinity [6].

Power electronics is a ubiquitous technology which has affected every aspect of electrical power networks, not just transmission but also generation, distribution and utilization. Deregulated markets are imposing further demands on generating plants, increasing their wear and tear and the likelihood of generator instabilities of various kinds. To help to

This work was supported in part by DGAPA-UNAM under project IN111510

C. Angeles-Camacho and F. Bañuelos-ruedas are with the Instituto de Ingeniería, Universidad Nacional Autónoma de México, México, D. F. 04512

E. Fariñas is with the faculty of Mechanical Engineering, Universidad Central las Villas, Villa Clara, Cuba (e-mail: farinas@uclv.edu.cu).

alleviate such problems, power electronic controllers have been developed to enable generator to operate more reliably in the new market place.

Power electronics circuits using conventional thyristors have been widely used in power transmission applications since the early seventies [7]. More recently, fast acting series compensators using thyristors have been used to vary the electrical length of key transmission lines, with almost no delay, instead of classical series capacitors, which is mechanically controlled.

III. FLEXIBLE ALTERNATING-CURRENT TRANSMISSION SYSTEMS

Power electronics form the basics of one devices family called FACTS, which offer a faster response times and lower maintenance costs compared to conventional electromechanical technology [8]. The FACTS concept is based on the incorporation of power electronic devices and methods into the high-voltage side of the network, to make it electronically controllable. FACTS controllers build on many advances achieved in high-current, high-power semiconductor device technology, control and signals conditioning [9]. The power networks have limits that define the maximum electrical power that can be transmitted, angular stability, voltage magnitude, thermal limits, transient stability, and dynamic stability are some of these limits [10], and any violations of these limits can cause damage to transmission lines and/or electric equipment. These limits have been relieve traditionally by the addition of new transmission and generations facilities, but FACTS controllers can enable the same objective to be met without major changes to the system layout. Figure 1 illustrates the active power compensation achieved by different kinds of FACTS devices.

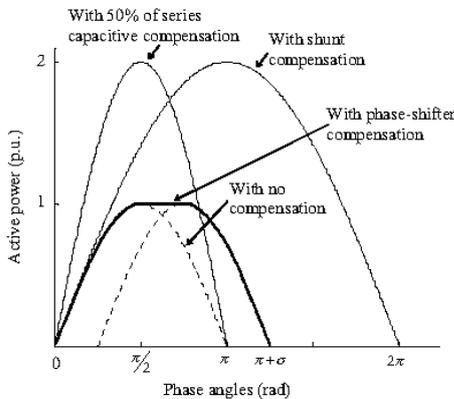


Figure 1. Active power transmission characteristic for different types of compensation

The new reality of making the power network electronically controllable, has began to alter the thinking and procedures that go into the planning and operation of transmission and distribution networks in the world.

From the operational point of view FACTS introduces additional degrees of freedom to control power flow over desired transmission routes, enabling secure loadings of transmission lines up to their thermal capacities. They also provide a more effective utilization of available generation and prevent outages from spreading to wider areas. A three-bus network is employed to illustrate the use of FACTS to active power flow control.

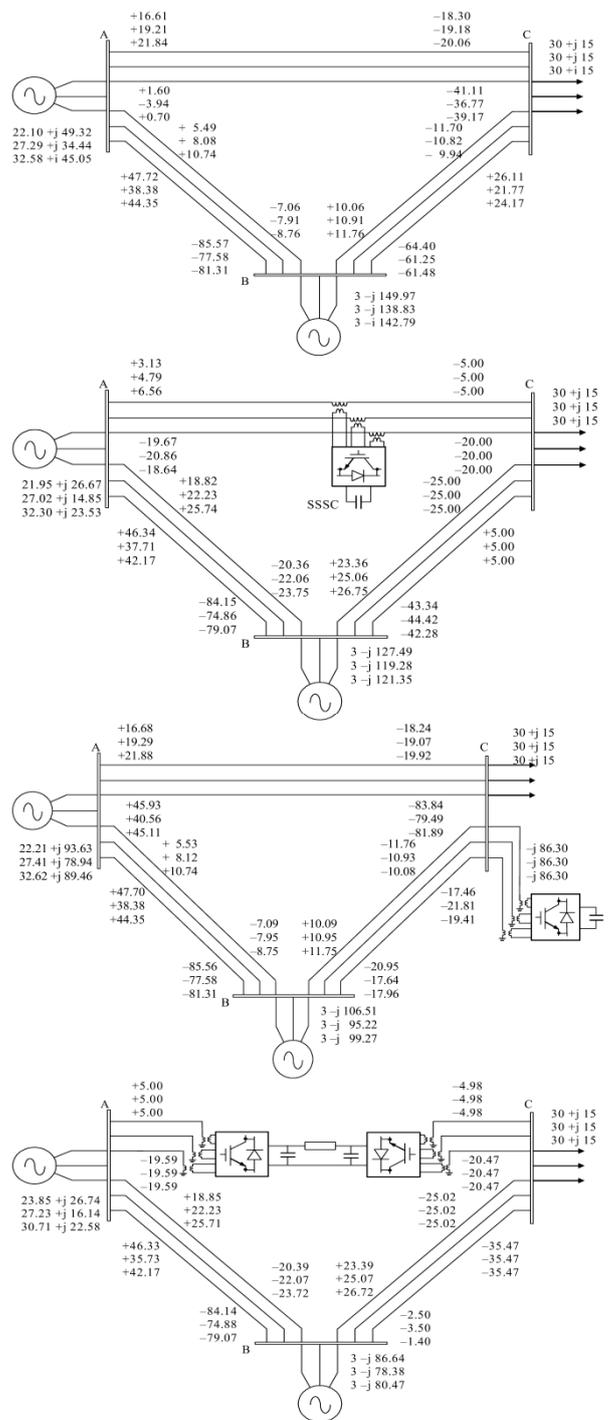


Figure 2. Active and reactive power flows for different kind of power control: a) without compensation, b) phase shift control, c) shunt compensation, d) DC link.

The new reality of making the power network electronically controllable, has began to alter the thinking and procedures that go into the planning and operation of transmission and distribution networks in many parts of the world. The potential benefits brought about by FACTS controllers include reduction of operation and transmission investment cost, increased system security and reliability, increase power transfer capabilities, an over enhancement of the quality of the electric energy delivered to customers, and environmental benefits gained by increased asset utilization, fig. 2 shows active and reactive compensation achieved by different kinds FACTS controllers[6].

Since FACTS devices are able to response quickly to voltage fluctuations and provide dynamic reactive power compensation, there is mounting evidence that they would be very successful when considering the effects of a varying source of energy, such as wind generation, on a network.

IV. WIND GENERATION

An interconnected power system is a complex enterprise that may be subdivided into four main components: generation, transmission, distribution and utilization. The source of the mechanical power, commonly known as the prime mover, may be hydraulic turbines, steam turbines whose energy comes from the burning of coal, gas and nuclear fuel, gas turbines, or occasionally internal combustion engines burning oil.

Interest in renewable energy started in earnest in the early 1980s following the oil crises of the 1970s when issues of security and diversity of energy supply and, to a lesser extent, long-term sustainability. Wind power generation become one of the most cost-effective and now is commercially competitive with new coal and gas power plants.

The wind resource is often best in remote locations, making it difficult to connect wind farms to the high-voltage transmission systems. Instead, connection is often made to the distribution system. The inclusion of a fluctuating power source like wind energy distributed throughout an electrical grid affects the control of the grid and the delivery of the stable power. The introduction of large amounts of wind power into the grid increases the short-term variability of the load as seen by the traditional generator, thus increasing the need for spinning reserve. It also changes the long-term means load as winds change, disrupting the planning for bringing generation on lines [10].

Wind power grid penetration is defined as the ratio of the installed power to the maximum grid-connected load. Presently, Denmark has the highest grid penetration of wind at 19%. It has been suggest that with additional technology, 50% grid penetration will be feasible. For instance, in the morning hours of 8 November 2009, wind energy produced covered more than half the electricity demand in Spain, setting a new record, and without problems for the network [11].

Induction generators are often used in wind turbines applications, since they are robust, reliable and efficient. They are also cost-effective due to the fact that they can be mass-produced. In the case of large wind turbines or weak grids, compensation capacitors are often added to generate the induction generator magnetizing current. Furthermore, extra compensation (such as a power electronic system) is added to compensate for the demand of the induction generator for reactive power. Some typical configurations of wind turbines connections are shown in Figure 3.

V. GRID INTEGRATION TECHNICAL PROBLEMS

There exist a number of barriers which slow down the wind power exploitation. As the interconnection of wind power involves a number of technical problems different challenges need to be addressed. The assessment of the technical impacts of an installation must be accomplish, those including,

- Transient Stability
- Voltage Control
- Frequency control

- Short Circuit Currents
- Power Quality Issues

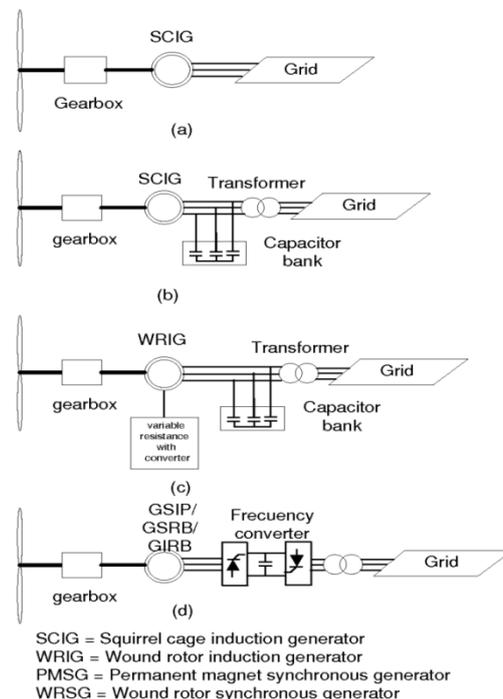


Figure 3. Typical wind turbines connections.

As the impact and consequently the level of penetration for power system network is an important issue. Methodologies and tools to overcome the technical problems need to be addressing to increase the wind power connection large-scale power system [12].

Transient Stability, traditional generator attempt to follow the fluctuating load in order to minimize voltage and frequency fluctuations. During fault (voltage depression) generators accelerates due to the imbalance between mechanical and electrical powers. When the fault is cleared they absorb reactive power depressing the network voltage, if no enough reactive power is supplied a voltage collapse is eminent. Synchronous generator exciter's increase reactive power output during low voltages and thus support voltage recovery, In contrast induction generator tent to impede voltage recovery. If the penetration of wind generation is high and they disconnect at small voltage reductions it can lead to a large generation deficit, to prevent this wind parks are required to have adequate compensation (Fault Ride Through Capability).

Voltage Control, Nodal voltages in power systems are normally allow to fluctuate from $\pm 5\%$ to up to $\pm 7\%$. Synchronous generator and other compensator devices regulate nodal voltage by supplying or absorbing reactive power. In contrast induction generators absorb reactive power and have no direct control over reactive power flows. Even variable-speed wind turbines may not be able to control the voltage at the point of connection, because the wind farm network is predominantly capacitive.

Frequency control, Frequency in large electric grids is maintained at $\pm 0.1\%$ of the desire value, in order to have

frequency control, generator power must increase or decrease. Wind generators responds to frequency changes by adjusting either, in fixed-speed the pitch angle or in variable-speed by operating it away from the maximum power extraction curve. In any case, thus leave a margin for frequency control in wind generation.

Short-Circuits Currents, The induction wind generators, contribute to the short-circuit current only in the instant of appearance of the fault. In contrast, during voltage depression a large short-current is needed, synchronous generators contribute “many times” their nominal current. With high penetration levels the risk of disconnections by voltage depression will increased.

Power Quality Issues, voltage harmonic distortion and flicker are the principal quality effects of wind power generation. The injection of harmonics into the power system is the main drawbacks associate with variable speed turbines because these contain power electronics. Voltages fluctuations (flicker) are produced by the variability of the power generated in fixed-speed wind turbines.

VI. WIND FARM MODEL

One of the tools more used in the electric systems planning and design is the analysis of power flows; a variant of this tool is the analysis of Dynamic Power Flows. Investors and companies execute the necessary preliminary studies.

The analysis will allow valuate the effects of the plant proposed over the network to be incorporate. However, models to perform the power flow analysis and understand the dynamic interaction between the wind farms and the electric systems are necessary to be developed.

A. The wind farm model

A basic model of a wind farm consists of four parts, the simulator of wind speed, the wind turbine with the gear box, the generator with its individual (optional) compensation and the electrical network to which it will be interconnected [13]. In case of not having compensation it will deliver the active power and will take of the network the reactive power, (Figure 3a), where there appears a wind generator of induction connected directly to the electrical.

The present work make use a model based on the scheme presented in the Figure 3(b), where an induction generator is connected to the network and compensation is supplied in order to supply the requirements of the generator’s reactive power.

The goal of the model is to calculate the active power provided by the wind generator, given the measured values of wind speed and his direction [14] as well as the reactive power, which depend on the active power and the voltage of connection. The active power produced by a turbine can be expressed by the following equation:

$$P = \frac{1}{2} \rho A v^3 C_p \quad (1)$$

where P is the real power in Watts, ρ is air density in kg/m^3 , A is the rotor area in m^2 , and C_p is the power coefficient. Figure 4 shows the wind speed (top) and the real power (bottom) produced by a wind farm. One month (February 2008) data for a place in Zacatecas is chosen from the wind model to model the output of the wind farm.

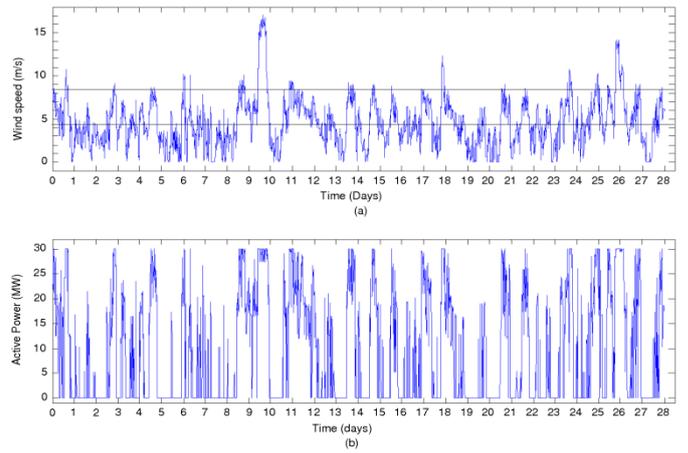


Figure 4. Wind speed (a) and the real power produced (b) by a wind farm.

Reactive power can be calculate using the steady-state model of the induction machine and applying the Boucherot’s theorem [15],

$$Q = \frac{V^2 (X_c - X_m)}{X_c X_m} + \frac{X (V^2 - 2RP) - X [(V^2 - 2RP)^2 - 4P^2 (R^2 + X^2)]^{\frac{1}{2}}}{2R^2 + 2X^2} \quad (2)$$

where V is the voltage, P is the real power, X is the sum of the stator and rotor reactances, X_c is the reactance of the capacitor bank, X_m is the magnetizing reactance, and R is the sum of the stator an rotor resistances. Both active and reactive powers are knows and the generator can be modeled as a PQ bus for power flow analyses and dynamic power flow analysis. The generator requires proportionally more reactive power at higher real power outputs. Figure 5 shows the relationship between active power production and reactive power absorption (top) and the respective reactive power absorption for the PQ model. The wind farm is modeled as being sitting at Zacatecas, México. Wind speed actual data for the month of February 2008 are used.

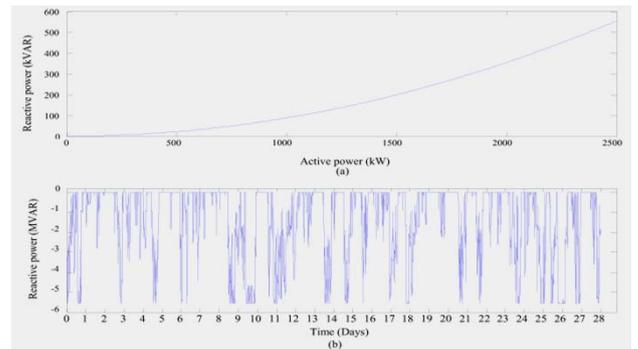


Figure 5. Relationship between active and reactive power (a) and reactive power generated in function of wind speed and nodal voltage (b).

VII. WIND INTEGRATION STUDY CASE: FACTS ROLE

Digital software for analysis and control of large-scale power networks under both balanced or unbalanced conditions was developed. The software was written in Visual C++ with the philosophy “Object Oriented Programming (OOP)”. The three-phase OOP power flow program has been applied to the analysis of a large number of multi phase power networks, of different sizes and complexity. Power flow solutions converge in five iterations or less to a tolerance of $1e^{-12}$, starting from a

flat voltage profile. The accuracies of the solution have been tested again commercial software and single-phase program [4].

A. Power flow case study

A small traditional network [9] shown in Figure 6 is used as the basis for illustrating how the PQ wind farm model for two kinds of power analysis tools, firstly a power flow analysis is performed and secondly a dynamic power flow analysis is carry-out. This is a five-bus network containing two generator, four loads and seven transmission lines. Figure 6, shows the test network used in the study with two particular solutions, (a) with zero wind power and (b) with maximum wind power (30 MW) which represents 15% of wind penetration. The Newton-Raphson power flow program takes a maximum of six iterations to reach convergence at each of the 4032 data points.

It can be observed from the results presented in Figure 6 and Table 1 that all nodal voltages are within accepted voltage magnitude limits, i.e. $100 \pm 6\%$ in the UK in both cases, minimum and maximum wind power injections. At minimum

wind power the largest power flow takes place in the transmission line connecting the two generator buses: 89.3 MW leave North. This is also the transmission line that incurs higher active power loss, i.e. 2.5 MW. The active power system loss is 6.12 MW per phase, this represent the 3.57 % of the active power generation. In maximum wind power injection the line is unloaded to 66.5 MW in general must lines are unloaded and losses are reduced to 4.66 MW. However, lines connecting Main-Wind changes the flow direction of power to wind-main. The line connecting Wind-Elm increase about three times the power flowing from Wind to Elm.

TABLE I. VOLTAGES OF FIVE-NODE NETWORK FOR ZERO AND MAXIMUM WIND POWER GENERATION

Nodal voltages	Wind power	Nodes at network					
		North	South	Lake	Main	Elm	Wind
Magnitude (p.u.)	Without	1.06	1.0	0.987	0.984	0.972	0.979
	Maximum	1.06	1.0	0.989	0.986	0.973	0.982
Phase Angle (degrees)	Whitout	0	-2.06	-4.64	-4.96	-5.77	-5.39
	Maximum	0	-1.25	-3.42	-3.51	-3.97	-2.60

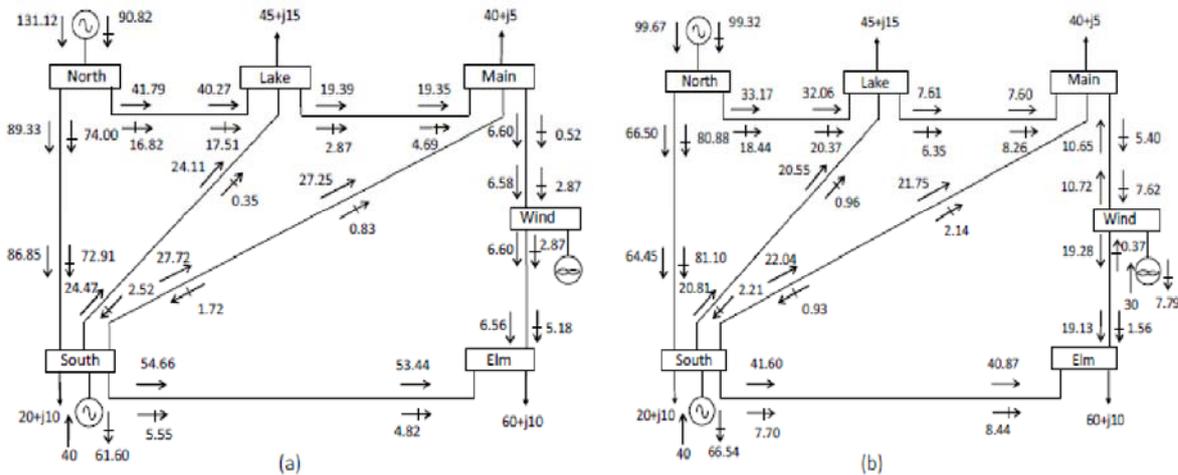


Figure 6. Five-bus test network, (a) with zero, and (b) within maximum wind generation.

The voltage magnitude profiles of all of the loads buses are affected by the variability condition of the primary source of power, the wind. Only bus slack (North) and PV bus (South) are not affected they remain constant at 1.06 and 1.0 pu. The wind farm was modeled with a source of reactive power that is equal to, the reactive power consumed by the generator at nominal voltage and real power. Figure 7 shows the voltage magnitude profile of nodal voltages of five-node network.

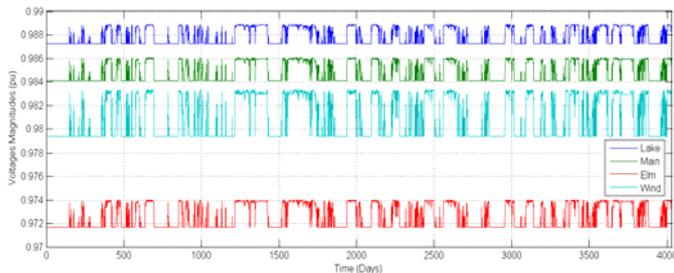


Figure 7. Nodal voltages profile of five-node network with wind power generation.

As can be seen in the previous figures, power generation using wind resources creates voltage fluctuations in the networks due to the varying injection of real power and varying absorption of reactive power, exposing the network to voltage deviations. Dynamic reactive power compensation with FACTS controllers can potentially stabilize the voltage fluctuations associated with the wind farms and provide seamless grid interconnection. Also, the sensitivity of the wind turbines to voltage trips can be improved. Dynamic reactive power compensation locally can allow the wind farm to remain operational during faulty conditions, this would avoid power unbalances or even system collapse. FACTS technology offers an attractive option when considering the effects of a varying source of energy, such as wind and solar generation.

The static compensator (STATCOM) is a power system controller VSC based suitable to provide dynamic compensation to transmission system. Its speed of response enables increased transient stability margins, voltage support enhancements, and damping of low frequency oscillation. The voltage generated by the STATCOM is adjusted with little delay by virtue of semiconductor valves switching. The STATCOM can be seen as an ideal voltage regulator for long-

term dynamic power flows. In other words magnitude voltage at the point connection is maintained at the set value in the face of voltage variations.

The five-bus network used is modified to include the STATCOM model [16]. Using the software developed a power flow analysis was carried out for the 4032 data points. It is used to control voltage magnitude at Lake at one per unit. The objective of this simulation is to assess the capability of the controller to keep a constant voltage magnitude at the connecting bus. The power flow results indicate that the STATCOM generates 20.45 MVAR, in order to achieve the voltage magnitude target at minimums wind power injection. Nodal voltages profiles of five-node network with wind power generation and within the STATCOM embed are shown in Figure 8.

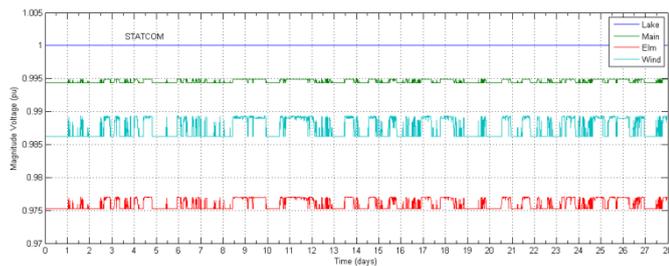


Figure 8. Nodal voltages profiles of five-node network with wind power generation and within the STATCOM embed.

Analyses of Figure 8 show that significant changes occur in nodal voltage magnitudes when the STATCOM is present in the network compared with the case study where no STATCOM is include. For one the voltage magnitude in the STATCOM bus boosted by the STATCOM is maintained at its set value one per unit. Keeping the voltage magnitude at the STATCOM bus at one per unit also flatted the remains nodal voltages.

B. Dynamic power flow case of study

The dynamic power flow enables the study of different kinds of disturbances, which may occur at any point in time during simulation time. Among these are load increments/decrements, switching in and out of transmission lines, short-circuits faults, and loss of generation.

The five-bus network was used for testing the dynamic power flow algorithm. For the purpose of this test case, both generators were selected to be steam power plants. Gains and time constants were adjusted to maximize dynamic effects. Generating plants were assumed equipped with AVR, governor and a three-stage steam turbine. The dynamic response of the network was assessed by simulating major disturbance events and less severe events causing only voltage step changes of different magnitudes.

Using the software developed, a dynamic power flow analysis was carried out. This case study is a sudden reduction of three-phase power system load following by a restoration to its normal level. The per phase load connected to bus Elm are disconnected and restored minutes later. It becomes apparent that any step load perturbations in power network loads have

an effect on the outputs of all generating plants in the interconnected system. Power generation is altered by the regulatory action of the speed governor and turbine; hence, frequency and nodal voltages are deviated from schedule values. The remaining variables at each generator are also altered.

The objective of this simulation is to assess the capability of the controller to improve transient stability and avoid the wind generation to be disconnect by voltage, frequency or load angle reduction after disturbs in the power network. If wind generation is disconnect can lead a large generation deficit. Figures 9 and 10 show the response of the generating plants to a step load disturbance for both cases (a) without compensation and (b) compensated.

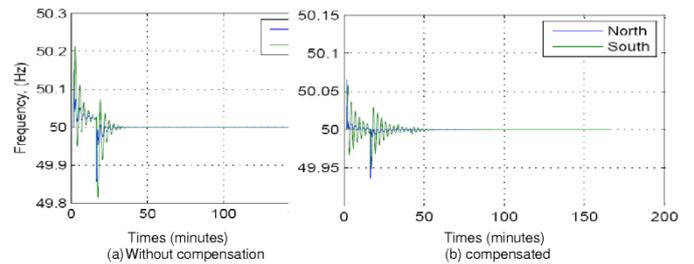


Figure 9. Frequency generating plant response of the system; (a) without and (b) with STATCOM.

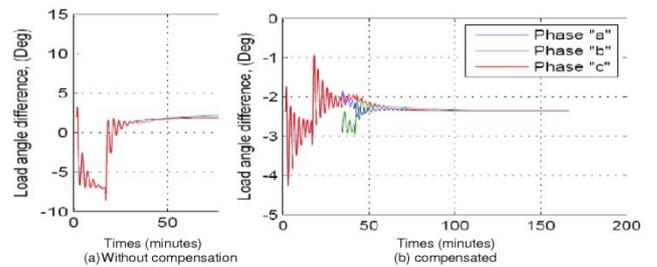


Figure 10. Load angle generating plant response of the system; (a) without and (b) with STATCOM.

VIII. CONCLUSIONS

Today there is an increasing demand for planning the connection of renewable generation in details seen from the perspective of the electricity grid.

A large-scale penetration of renewable requires improvements in the infrastructure of the transmission network, both within a national electrical system and in the interconnections between countries, to balance variable power output and demand across regions and to transmit the renewable energy generated by non-conventional Renewable energies (NCRE) power stations.

These are typical questions that have to be considered by the system operator before commissioning a power plant using renewable energies. Is there a risk of low voltage gradients due to changes of the renewable resource?, How would a black out of a wind farm affect the stability of the grid?, Can the wind farm run through a 3-phase-fault on the grid?.

Load flow analyses and dynamic studies have to be made in advance to analyze how the decentralized power production from renewable energies would affect the load flow conditions in the grids. This paper focus on used a wind farm model suitable for incorporation in both power flow analysis and dynamic power flow analysis. The paper present a set of case studies to illustrate befits that FACTS technologies bring to facilitate the connection of wind power to power systems.

REFERENCES

- [1] Gallardo Q.F., “*Estabilidad y Amortiguamiento de Oscilaciones en Sistemas Eléctricos con Alta Penetración Eólica*”,(in Spanish) Tesis Doctoral, Departamento de Ingeniería Eléctrica, Electrónica y Automática, Universidad Carlos III de Madrid. 2009.
- [2] Angeles-Camacho, C. and Bañuelos-Ruedas, F., “*Incorporation of a Wind Generator Model into a Dynamic Power Flow Analysis*”, in Spanish, (in press), Ingeniería. Investigación y tecnología. Revista de la Facultad de Ingeniería de la Universidad Nacional Autónoma de México.
- [3] Mohan, N., Undeland, T. M. and Robbins, W. P.: “*Power Electronics: Converter Applications and Design*”, John Wiley & Sons, 3rd Edition, 2003.
- [4] Angeles – Camacho, C. “*Phase domain modeling and simulation of large-scale power systems with VSC-based FACTS equipment*”. A thesis submitted to the Dep. of Elec. & Elec. Eng. of the University of Glasgow for the degree of Doctor of Philosophy, March 2005.
- [5] Anderson, P. M. and Fouad, A. A.: “*Power System Stability and Control*” (Revised Printing). New York: IEEE Press. 1994.
- [6] CIGRE: “FACTS Technology for open access”, JWG 14/37/38/39-24. Final draf report, August 2000.
- [7] IEEE Power Engineering Society: “FACTS Applications”, Special Issue, 96TP116-0, IEEE Service Center, Piscataway, N.J., 1996.
- [8] Hingorani, N.G., Gyugyi, L.: “*Understanding FACTS: Concepts and Technology of Flexible AC Transmission Systems*”, the Institute of Electrical and Electronics Engineers, Inc., New York, 2000.
- [9] Acha, Fuerte, Ambriz, Ángeles. “*FACTS. Modeling and Simulation in Power Networks*”, John Wiley & Sons, 2004.
- [10] Song, Y:H: and Johns, A.T., “*Flexible AC Transmission Systems (FACTS)*”, Institution of Electrical Engineers, London, 1999.
- [11] Manwell, J. F., McGowan, J.G. and Rogers, A.L., “*Wind Energy Explained*”, John Wiley & Sons, 2002.
- [12] Red Española de Eenergia http://www.ree.es/ingles/sala_prensa/web/notas_detalle.aspx?id_notas=117, consulted may 2010.
- [13] Diaz-Guerra B., “*Integración de la generación eólica en el sistema eléctrico español Experiencia del Operador del Sistema*”, Seminario Internacional Santiago, Chile October 2007
- [14] Feijoo A.E, Cidras J. , "Modeling of wind farms in the load flow analysis", IEEE Trans. PS, vol. 15, no. 1, Feb. 2001, pp. 110-115.
- [15] Abo-Khalil A.G, y Lee D., “*Dynamic Modeling and Control of Wind Turbines for Grid Connected Wind Generation System*”, Power Electronics Specialists Conference, 2006. PESC '06. 37th IEEE Publication.18-22 June 2006.
Ackerman T. Editor. *Wind Power in Power Systems*. Second Edition. USA. John Wiley and Sons. 2005.
- [16] Angeles-Camacho, C. and Barrios-Martinez, E.: “*Dynamic Phase-domain Modelling and Simulation of STATCOM in Large-scale Power Systems*”, 2009 IEEE Bucharest POWERTECH, Proceedings, Bucharest, Rumania, Julio 2009.